


Fuel Test Report

Date Sampled: 15/07/2021
Date Tested: 16/07/2021
Site: [REDACTED]
Sample ID: Tank 1 **Sample Serial Number:** [REDACTED]
Source of sample: Off Bottom
Engineer: [REDACTED]

Visual (ASTM D4176)	Clear and Bright	F.A.M.E (%) (ASTM D8274)	0.06
MBG/Debris (Visual)	No MBG/Debris	Density (ASTM D7777)	826
Free Water (Visual)	No	pH (In-house)	N/A
Flashpoint (*C) (ASTM D975)	>55	Cetane (ASTM D613)	48.9
ATP Test (AOAC Certified)	0	Dielectric Strength (In-house)	51.85
Moisture (PPM) (ASTM D6304)	<200	Cloud point (*C) (ASTM D7397)	-5.8
Impurities (In-house)	None		

Cleanliness (ASTM D8166-21)	ISO 4406
Recommended (4µm)	18
This sample	17
Recommended (6µm)	16
This sample	15
Recommended (14µm)	13
This sample	10

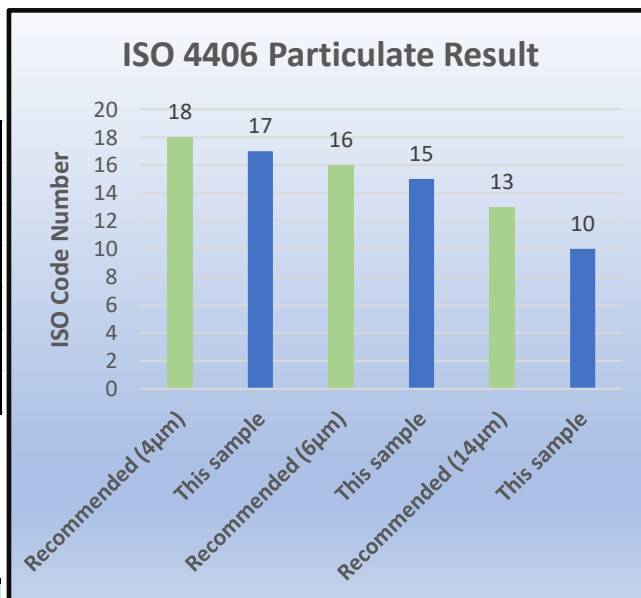

Result Within specification

Notes

Recommendations

None.